

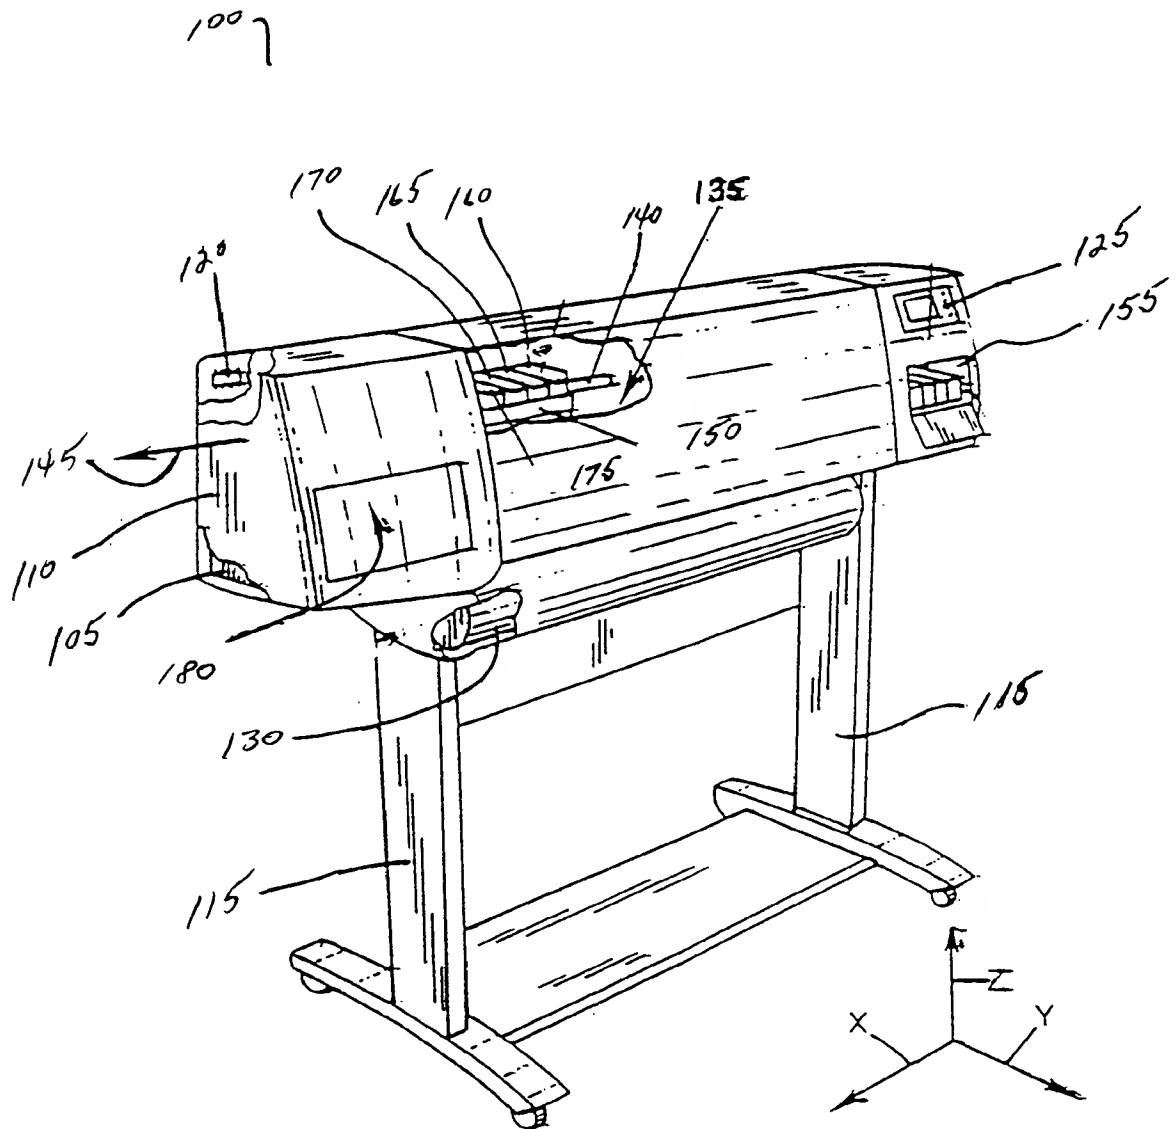
[illegible]

FIG. 2

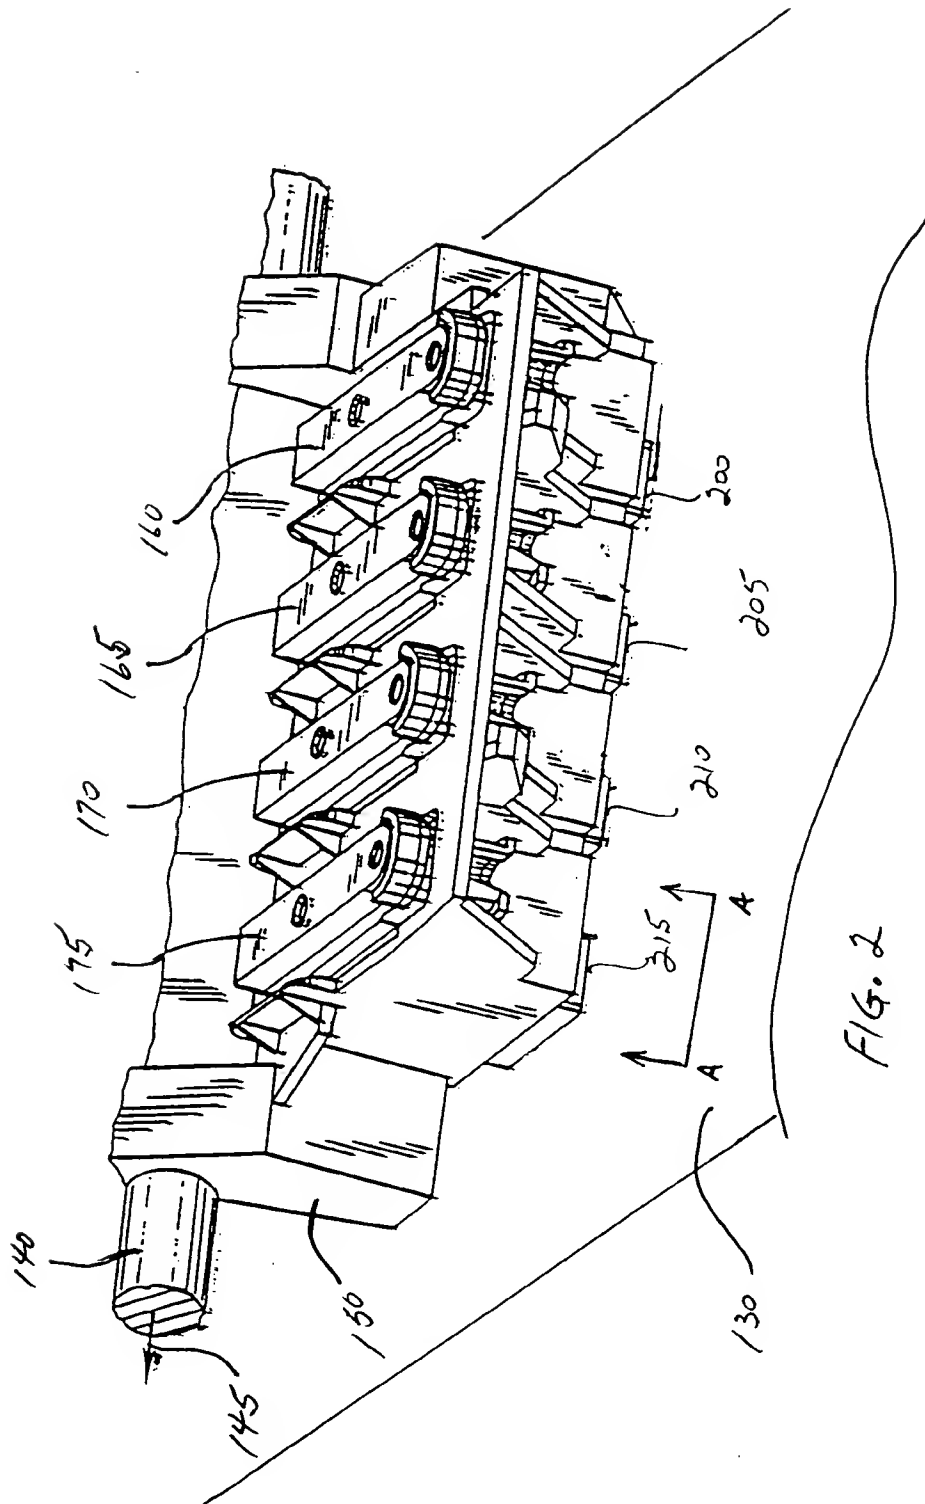


FIG. 2

09998799-103101
T07E0T 66Z86660

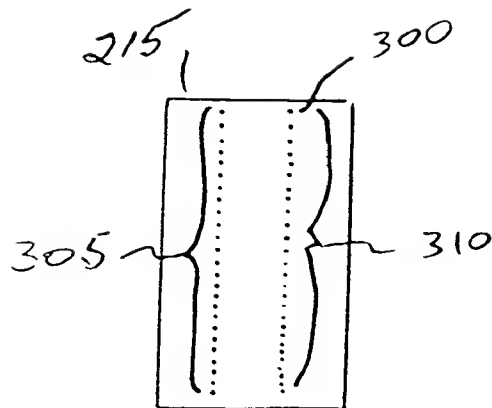
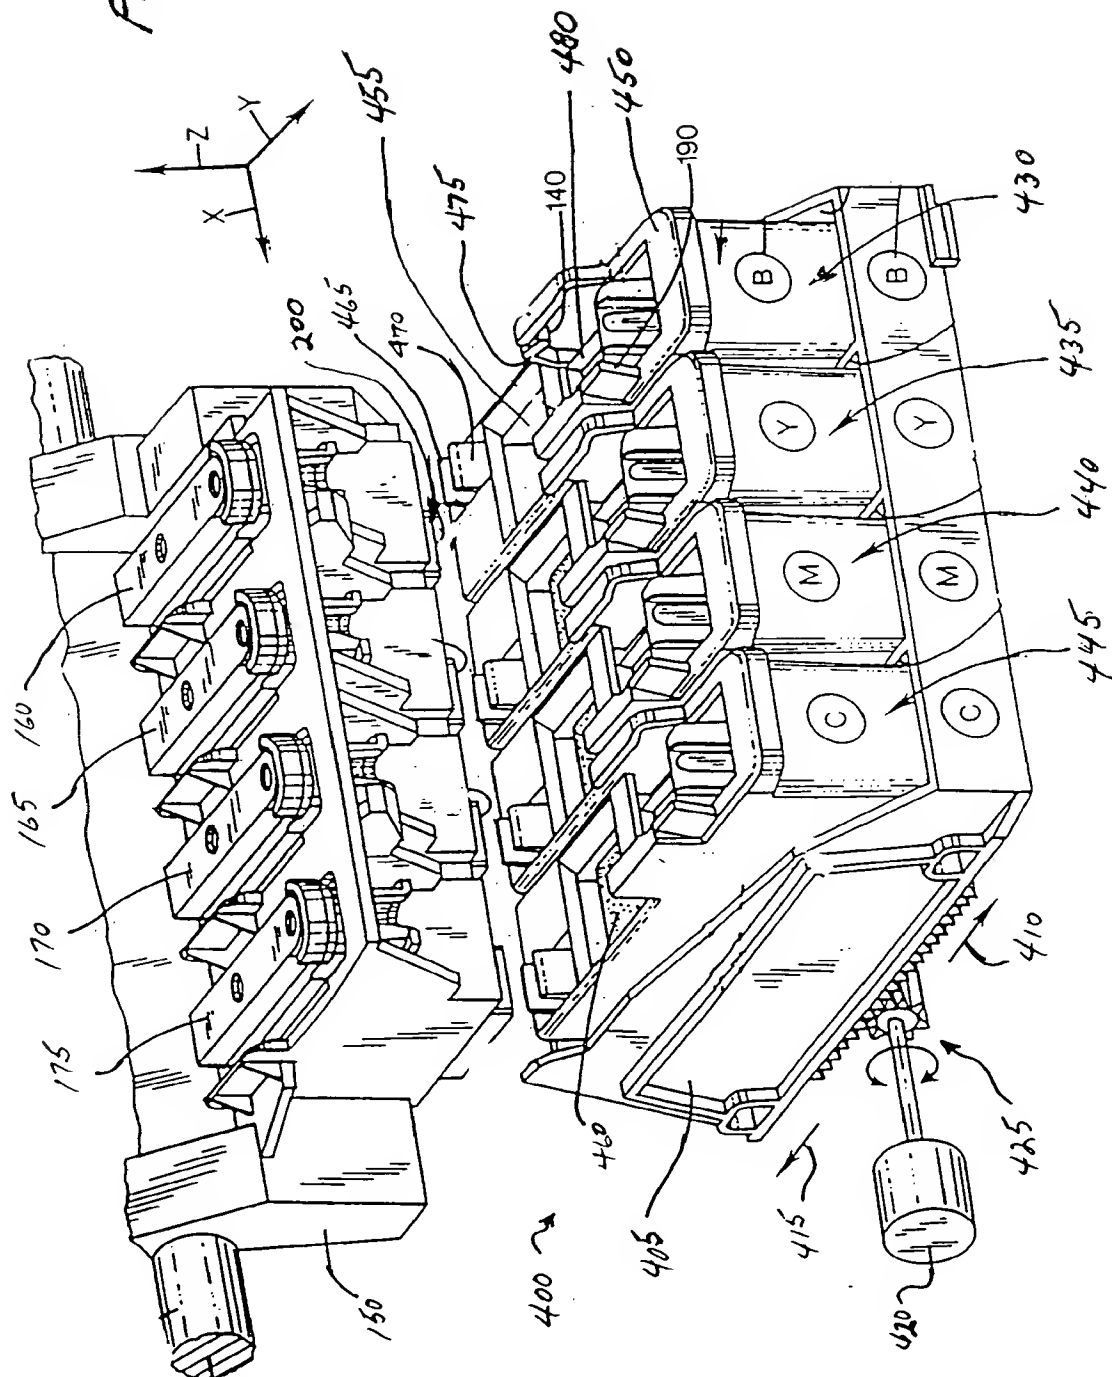


FIG. 3

Fig 4



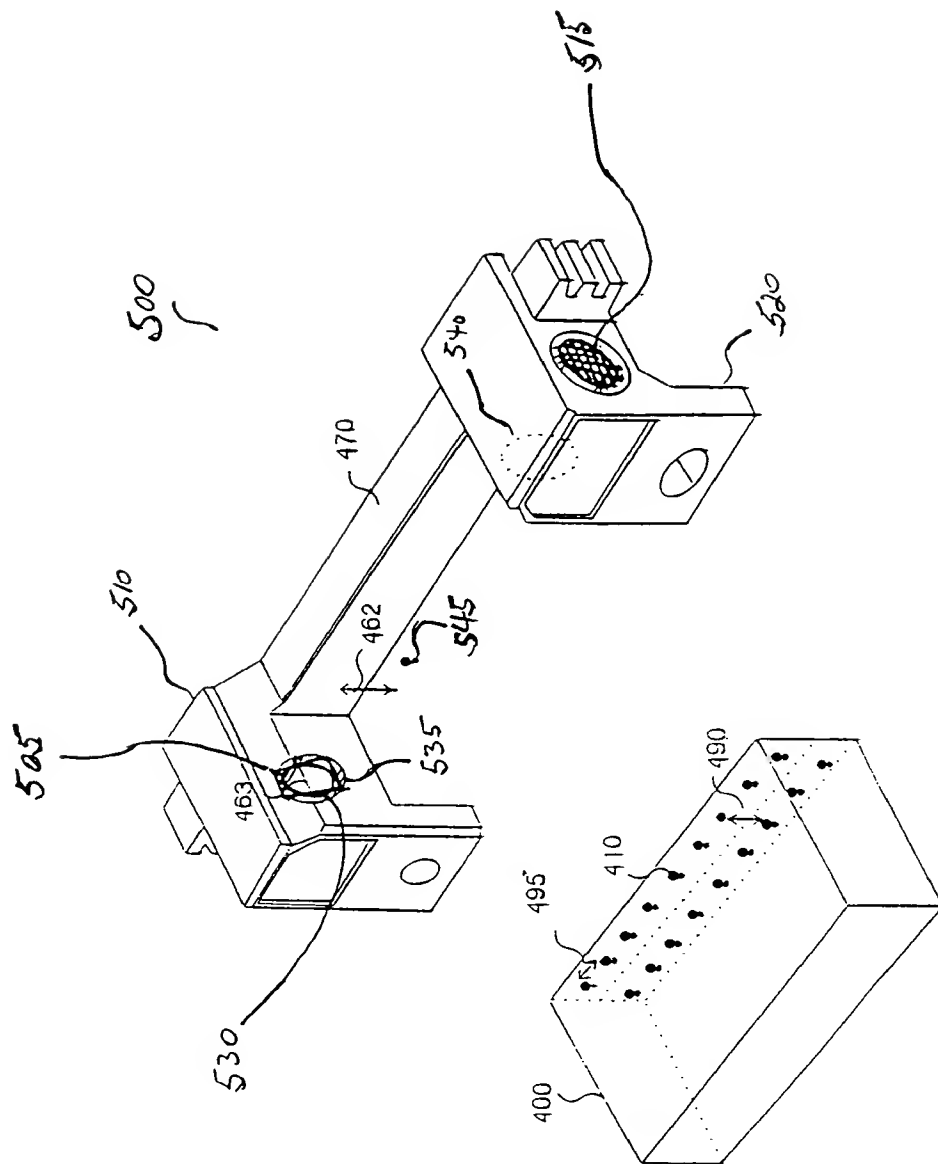


Fig. 5

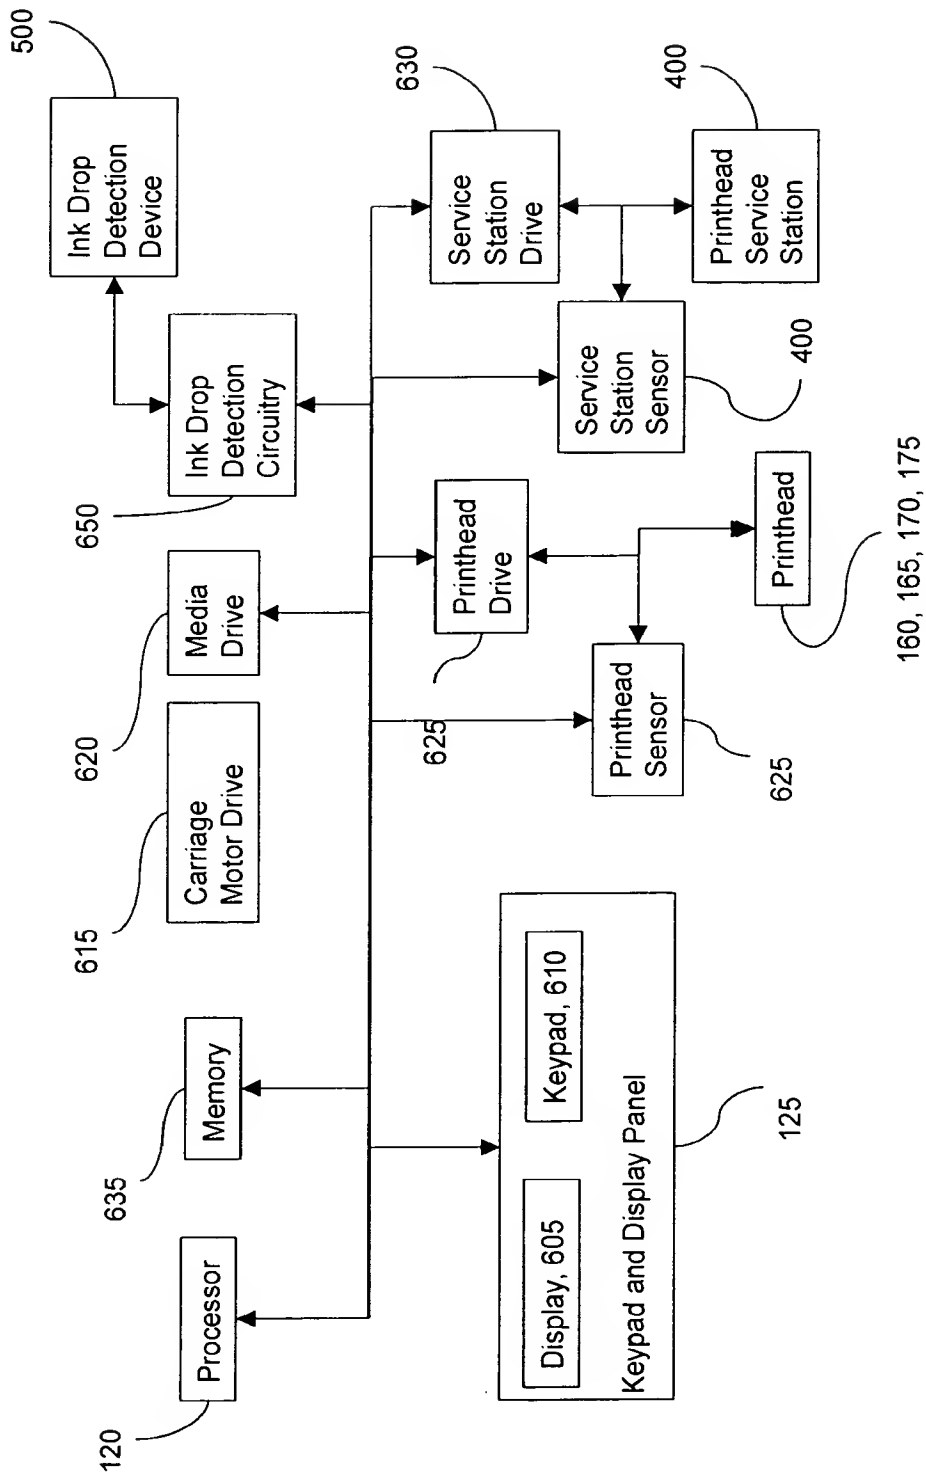


Figure 6

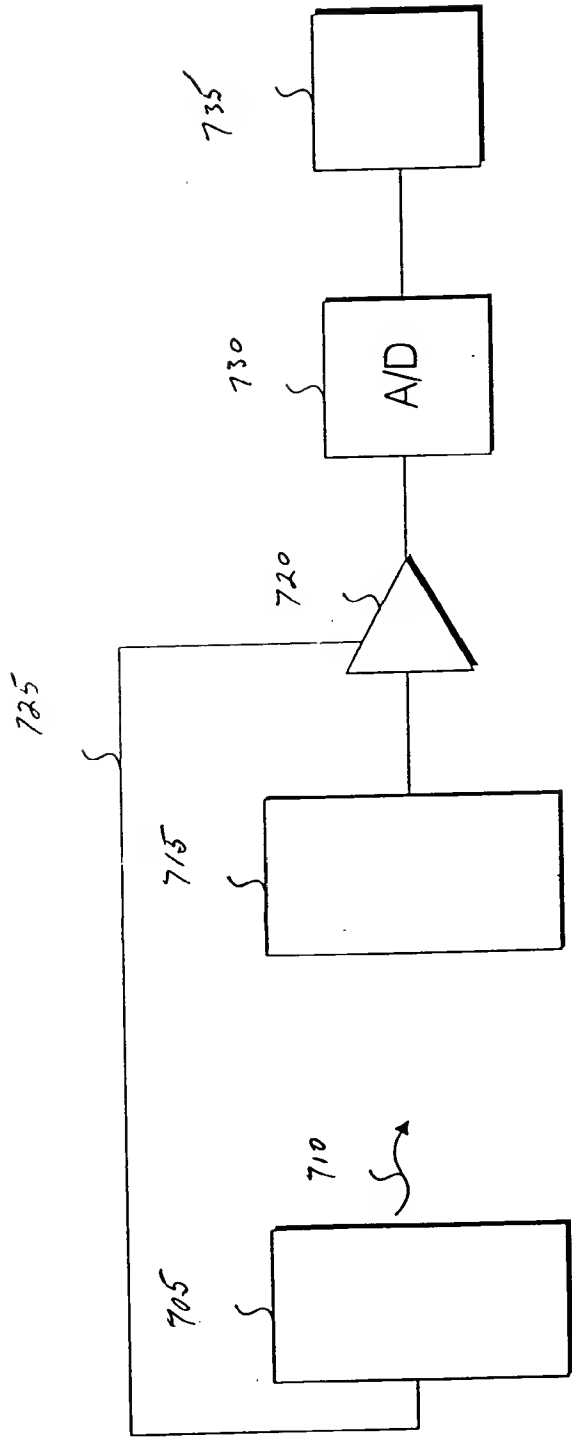


Fig. 7

101601 66236600

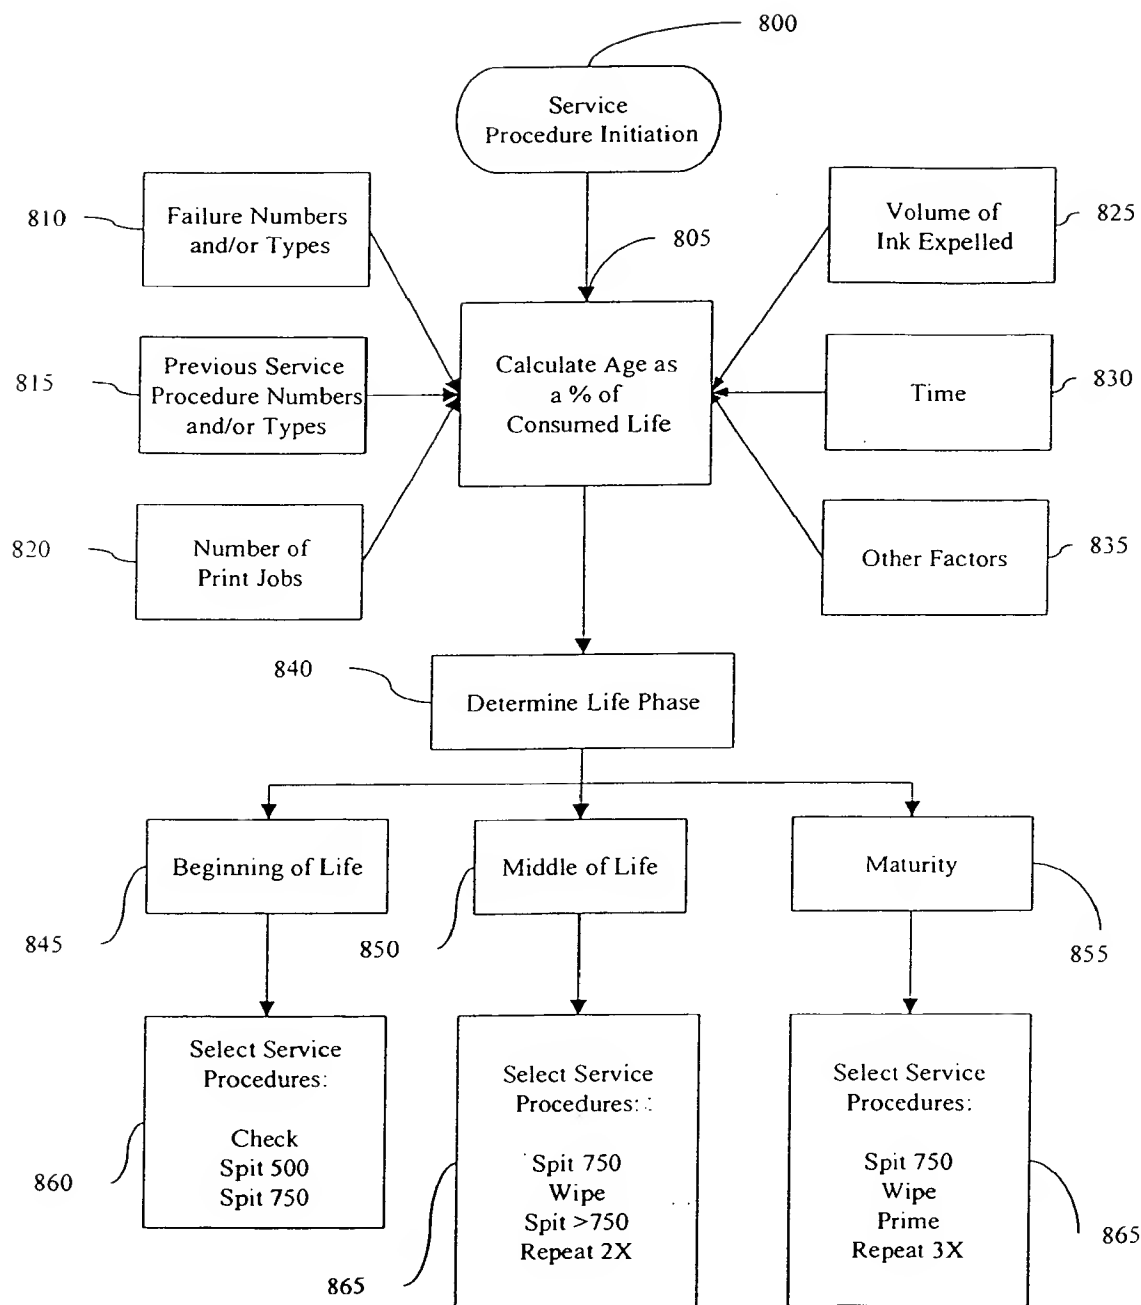


Figure 8

FIG. 9

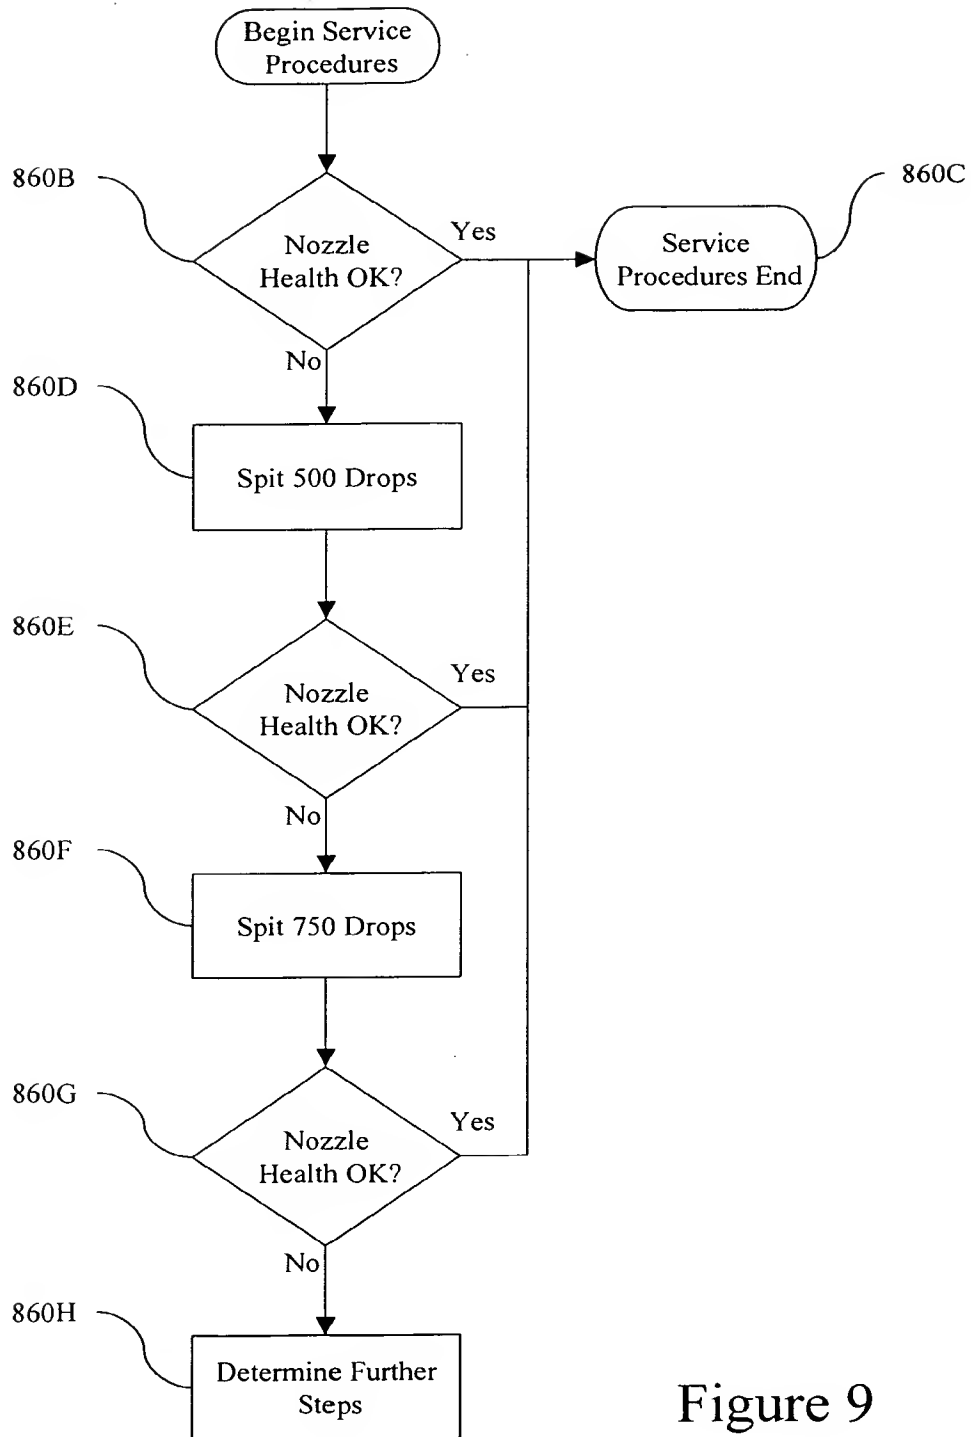


Figure 9

```

graph TD
    Start([Begin Service Procedures]) --> Spit750[Spit 750 Drops]
    Spit750 --> HealthOK1{Nozzle Health OK?}
    HealthOK1 -- Yes --> End([Service Procedures End])
    HealthOK1 -- No --> SpitGT750[Spit >750 Drops]
    SpitGT750 --> HealthOK2{Nozzle Health OK?}
    HealthOK2 -- Yes --> End
    HealthOK2 -- No --> Spit750Again[Spit 750 Drops]
    Spit750Again --> HealthOK3{Nozzle Health OK?}
    HealthOK3 -- Yes --> End
    HealthOK3 -- No --> Executed2X{Procedures Executed 2X}
    Executed2X -- No --> Spit750
    Executed2X -- Yes --> DetermineSteps[Determine Further Steps]

```

Figure 10

Figure 10

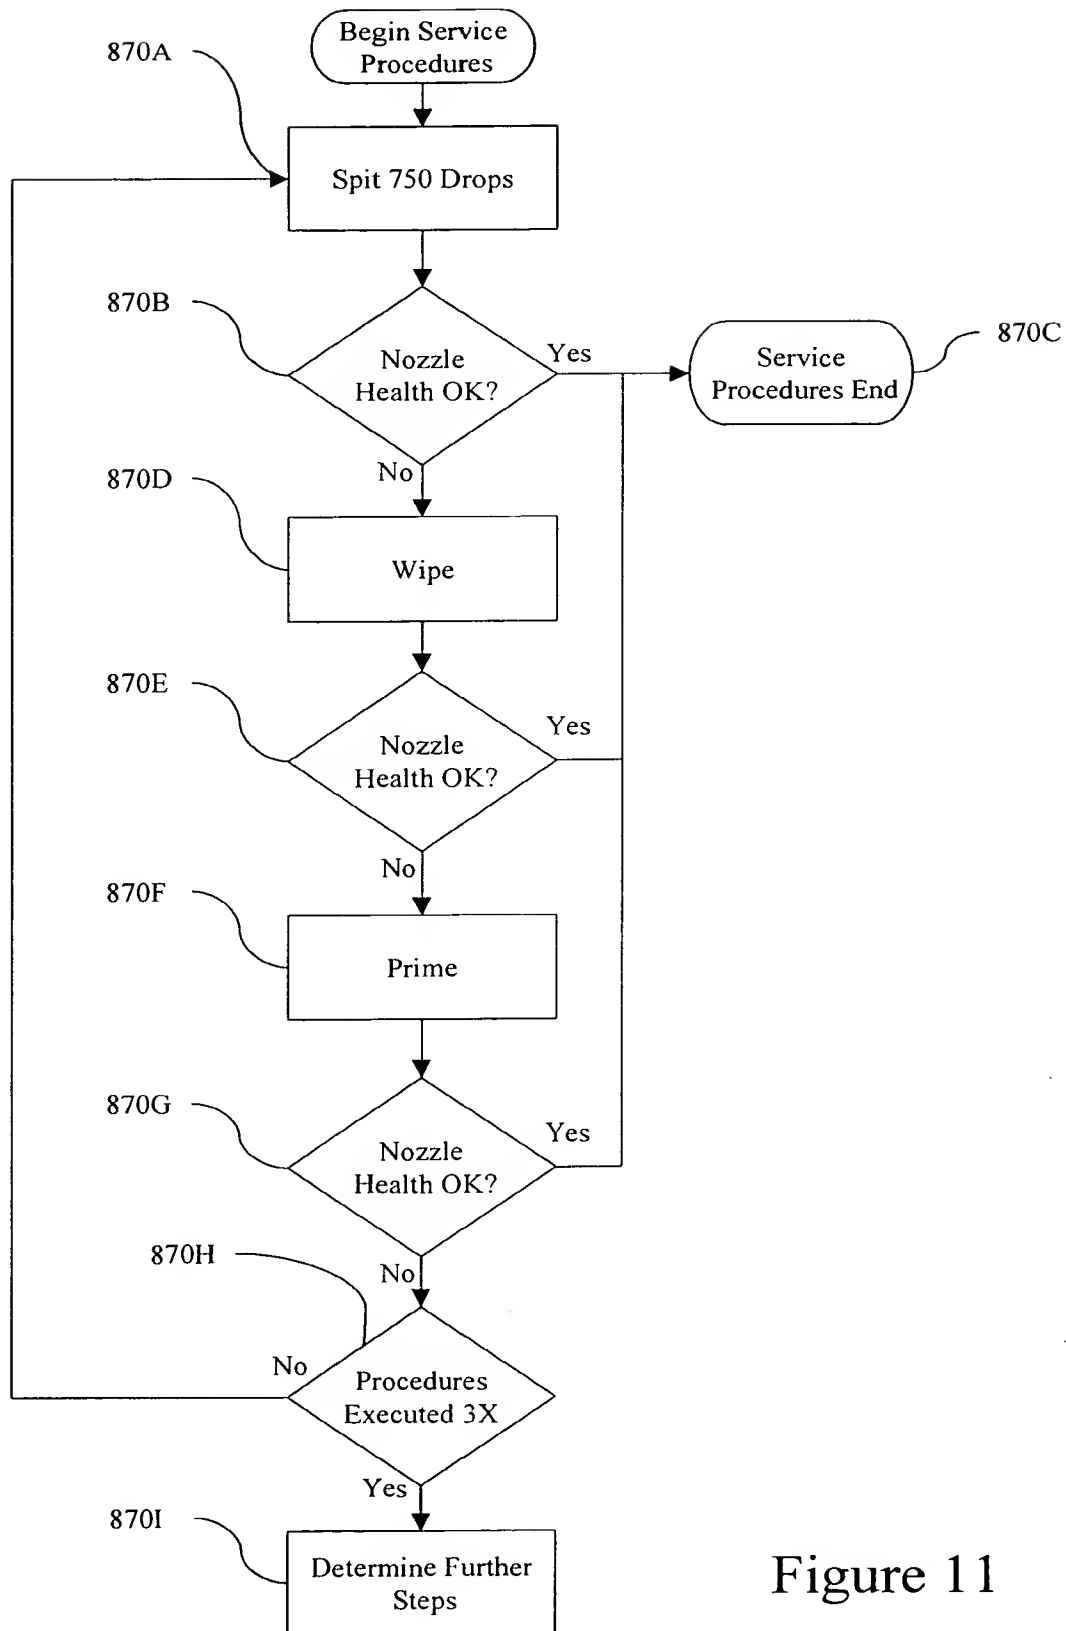


Figure 11